


Quality Conservation protection River drinking Gilbert
 system public 2015 Water Convenient groundwater lakes compounds
 Affordable safe tested Quality Report
 report treatment monitoring levels canal rivers Refreshing

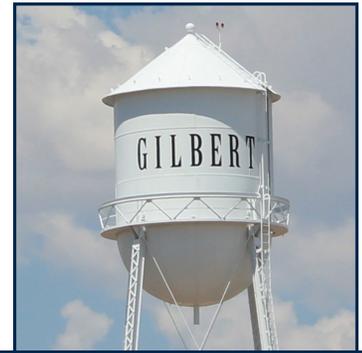

• **What is a Water Quality Report?**

Gilbert is pleased to present the 2015 annual drinking water quality report as required by the Environmental Protection Agency's (EPA) [Safe Drinking Water Act](#) (SDWA). This report is designed to provide details about where your water comes from, what it contains, and how it compares to the standards set by regulatory agencies. This report is a snapshot of your water quality in Gilbert in 2015, and discloses information on any contaminants detected in your water. This report is also Gilbert's opportunity to tell the story of the water division's activities, programs and process improvements in 2015.


• **Where does my water come from?**

Gilbert's primary source of drinking water is surface water. Surface water is supplied to Gilbert's two water treatment plants by an extensive canal network from the [Salt River Project](#) (SRP) and the [Central Arizona Project](#) (CAP). SRP manages a series of dams and reservoirs along the Salt River and Verde River watersheds, storing water for times of low rainfall and drought. Water collected in these reservoirs is released into SRP canals. CAP operates and maintains a 336 mile long canal system which carries Colorado River water from Lake Havasu, through Phoenix, to south of Tucson.

• **North Water Treatment Plant**

Called the North Water Treatment Plant (NWTP) due to its location in northern Gilbert, the plant is situated on the eastern canal and receives water from SRP. The SRP canal delivers a mixture of water from the Salt River, the Verde River and groundwater wells to the plant where it is then treated using conventional treatment methods of coagulation, flocculation, sedimentation, and filtration with ozonation and chlorine disinfection. The NWTP can produce as much as 45 million gallons of water per day (MGD) and has a 16 million gallon (MG) reservoir for onsite water storage.

▶▶▶▶▶▶▶▶▶▶ **Gilbert's Water Sources at a glance**

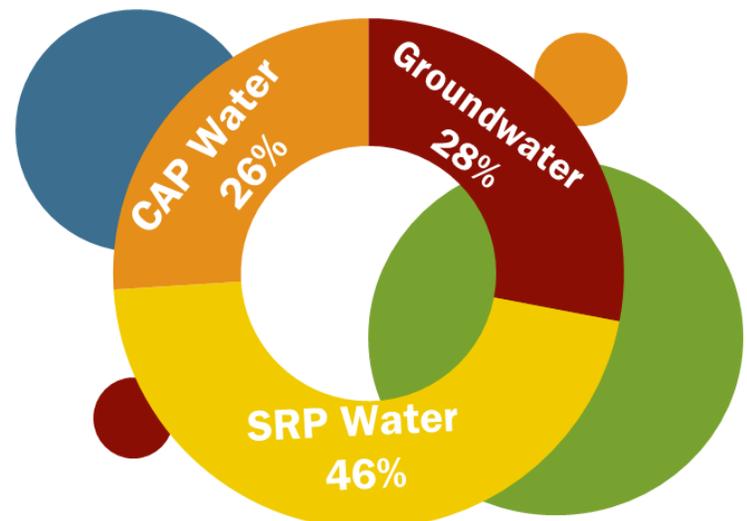

- **Santan Vista Water Treatment Plant**

Called Santan Vista because of the stunning view of the San Tan Mountains from the control room, this plant receives water from the Central Arizona Project (CAP) canal system, which diverts water from the Colorado River watershed. From the CAP canal turnout, water is brought to the plant through 14 miles of 48" diameter ductile iron pipeline. This plant was built and operates in partnership with the City of Chandler which uses 12 MGD of Santan Vista's 24 MGD production capacity. The Santan Vista water treatment plant operates using ballasted flocculation and filtration with ozone and on-site generation of sodium hypochlorite for disinfection.

- **Groundwater**

Groundwater is used in Gilbert to supplement the surface water supplies to meet water demand during peak times and during canal and water treatment plant scheduled maintenance. Groundwater is pumped from any number of the 17 wells located throughout Gilbert where it can be put directly into the distribution system or can be used to fill a water storage reservoir. At some well sites, ion exchange or adsorptive media are

used to reduce the concentration of inorganic contaminants native to the groundwater to below EPA maximum contaminant levels (MCLs) prior to delivery.

- **Source water assessment and its availability**


In 2004, the Arizona Department of Environmental Quality (ADEQ) completed a Source Water Assessment (SWA) for the 12 groundwater wells (at the time of the assessment) and one water treatment plant used by Gilbert. The assessment reviewed and evaluated adjacent land uses to the aforementioned locations that may pose a potential risk to water, and the quality thereof, served to the community from those sources. These risks may include, but are not limited to, gas stations, landfills, dry cleaners, and agriculture fields.

The result of the SWA led to the identification of 10 sources with a low risk susceptibility and three sources identified as high risk. Those sites receiving a high risk designation are located in proximity to a gas station, agriculture field, and an industrial park. None of the locations, including those with a low risk assessment, have detected contamination; however, Gilbert remains vigilant in their monitoring to ensure the best water quality is served to our community. Residents can help protect source

water by taking hazardous household chemicals to hazardous material collection sites and by limiting the amount of pesticide and fertilizer use in the home. The SWA is available to the public by request from the Clerk's Office, or visit the ADEQ's SWA Unit website at azdeq.gov/environ/water/dw/swap.html for more information.

- **Are there contaminants in my drinking water?**

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a

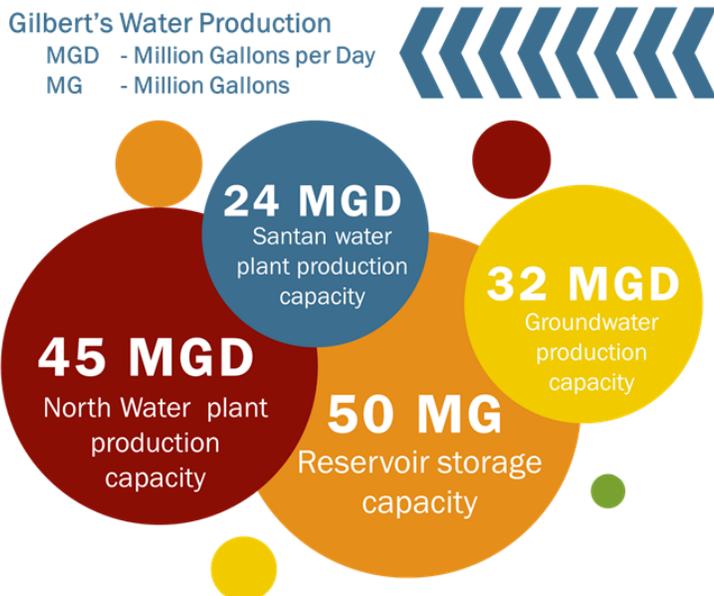

Want to hear more from your water division?

Sign up for our water conservation emails at gilbertaz.gov/water for project updates and water news!

health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's (EPA) Safe Drinking Water Hotline (800-426-4791).

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity: microbial contaminants, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife; inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban storm water runoff, industrial, or domestic wastewater discharges, oil and gas production, mining, or farming; pesticides and herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses; organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff, and septic systems; and radioactive contaminants, which

can be naturally occurring or be the result of oil and gas production and mining activities. In order to ensure that tap water is safe to drink, EPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water which must provide the same protection for public health.



• Do I need to take special precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Water Drinking Hotline (800-426-4791).

• How can I get involved?

The Gilbert Town Council consists of the mayor and six council members who serve four year terms. Unless otherwise noted, the council meets every other Thursday at 7 p.m. in the Gilbert Municipal Center, 50 E. Civic Center Drive. Council agendas are posted on this website at least 24 hours prior to meeting time.

gilbertaz.gov/council

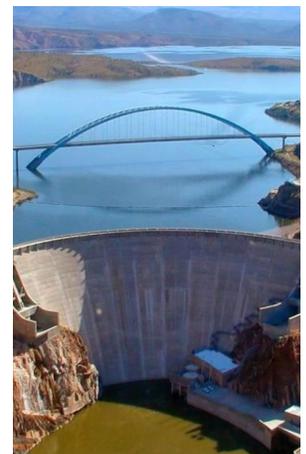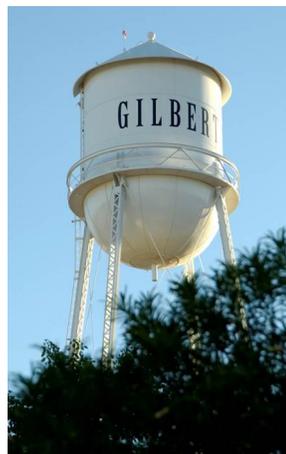

Painful water bill?

Schedule a free water checkup and we'll diagnose the problem.

Water checkups are performed by a trained Water Conservation Specialist who evaluates the irrigation system, checks for water leaks, and offers customized recommendations for increased water savings at your residence or business.



gilbertaz.gov/watercheckup

• What can I do to save water?

Residential customers:

- Eliminate wasteful water use like leaks. Use the smart Home Water Guide at smarthomewaterguide.org to learn how to find and fix leaks in your home.
- Water your landscape efficiently. Up to 70% of residential water use is outdoors; find out how much water your yard needs to be healthy at landscapewateringguide.com.
- Take a free landscape class to learn how to work your irrigation system. Visit gilbertaz.gov/waterworkshops to learn more.
- Learn how to use water efficiently around your home by visiting gilbertaz.gov/water and watch one of Water Conservation's educational videos.
- If you're replacing any appliance or fixture that uses water, look for a Watersense label to ensure your new uses. Learn more about Watersense at epa.gov/watersense.
- If you hire a Smartscape trained professional find a certified Smartscape landscaper at smartscape.org/directory.
- If your water use is higher than you think it should be, and can't figure out why, email us at WaterConservation@Gilbertaz.Gov to request a free water audit from Gilbert Water Conservation.

Businesses, schools, churches, HOAs, and other non residential customers:

- Gilbert offers a free HOA Landscape Irrigation Assistance Program designed to reduce water use while maintaining an attractive landscape. Find out more at gilbertaz.gov/HOA-Irrigation
- Become a Water Wise Gilbert organization by participating in Gilbert's free commercial recognition program at gilbertaz.gov/waterwise

Does your water use add up?

How much water should my household use?

FIND OUT!
TRY THE NEW
Gilbert Water Calculator

+

-

=

x

?

?

\$

?

• GILBERTAZ.GOV/WATERCALCULATOR •

• How does Gilbert deliver water?

Gilbert's water distribution system is comprised of over 1200 miles of underground piping ranging in size from 4-inches in diameter to 48-inches in diameter. Gilbert's underground piping network is essential to ensure the safe delivery of water to all water customers. Gilbert serves various types of customers including; private homes, industrial facilities, commercial properties and institutional establishments. Gilbert's water distribution piping network is designed to maintain a positive pressure and typically operates between 60 and 80 psi (pounds per square inch). Positive pressure is needed to ensure treated drinking water reaches all parts of Gilbert's underground piping network. Gilbert's water distribution division works hard to ensure that every Gilbert customer and resident has access to this water, and to do so they operate, inspect, repair and replace these critical components of our drinking water infrastructure:

12,313 Fire Hydrants

- Provide accessible water for fire fighting, fire flow testing and inspections, construction needs, street sweeping, and water quality flushing programs.
- In 2015, Gilbert performed preventative maintenance on more than 2,600 fire hydrants and was able to repair 202 fire hydrants to full operability, saving \$800,000 over the cost of replacement hydrants.



1,297 Miles of Pipe

- In 2015, Gilbert repaired 25 water main breaks. Water main breaks can be caused by construction activities, or by natural environmental changes including extreme temperature fluctuations.
- Over 80% of the water mains in Gilbert are made of PVC (Polyvinyl Chloride)



81,267 Water Meters

- Water meters are used to accurately record water consumption for each Gilbert customer. Gilbert's water meter department reads all meters monthly, and replaces over 5,000 meters every year.
- Gilbert's water meter testing program ensures that water meters accurately record consumption. Each water meter must be accurate within +/- 1.5% to pass.



35,765 Isolation Valves

- Gilbert's water department maintains valves by exercising them on a regular basis. Each year, over 7,000 valves are exercised by opening and closing them with a valve key.
- Valves range in size from 4 to 48 inches in diameter. A 48 inch valve takes a full 450 revolutions of a valve key in order to open or close the valve.



• Your Water Quality

In order to ensure that tap water is safe to drink, EPA prescribes regulations which limit the amount of contaminants in water provided by public water systems. The following tables list all of the drinking water contaminants that were detected during the calendar year of this report. Although many more contaminants were tested, only those substances listed below were found in your water. All sources of drinking water contain some naturally occurring contaminants. At low levels, these substances are generally not harmful in our drinking water. Removing all contaminants would be extremely expensive, and in most cases, would not provide increased protection of public health. A few naturally occurring minerals may actually improve the taste of drinking water and have nutritional value at low levels. Unless otherwise noted, the data presented in these tables are from testing done in 2014. The EPA or the State requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not vary significantly from year to year, or the system is not considered vulnerable to this type of contamination. As such, some of our data, though representative, may be more than one year old. In these tables you will find terms and abbreviations that might not be familiar to you. To help you better understand these terms, we have provided the definitions.

• Definitions

AL:	Action Level - The concentration of a contaminant which, if exceeded, triggers treatment or other requirements
MCL:	Maximum Contaminant Level - The highest level of a contaminant that is allowed in drinking water
MCLG:	Maximum Contaminant Level Goal - The level of a contaminant in drinking water below which there is no known or expected risk to health
MFL:	Million Fibers per Liter
MRDL:	Maximum Residual Disinfectant Level - The level of disinfectant added for water treatment at that may not be exceeded at the customer's tap.
MRDLG:	Maximum Residual Disinfectant Level Goal - The level of disinfectant added for water treatment at which no known or anticipated adverse effect on health of persons would occur.
MREM:	Millirems per year - a measure of radiation absorbed by the body
NA:	Not Applicable
ND:	Not Detected - Concentration too low to be detected
NTU:	Nephelometric Turbidity Units - a measure of the clarity of water
pCi/L:	Picocuries per liter - a measure of the radioactivity in water
PPM:	Parts Per Million - or milligrams per liter (mg/L)
PPB:	Parts Per Billion - or micrograms per liter ($\mu\text{g/L}$), 1000 ppb = 1 ppm
PPT:	Parts Per Trillion - or nanograms per liter (ng/L), 1000 ppt = 1 ppb
RAA:	Running Annual Average - Average value of a contaminant at a location in a year
TT:	Treatment Technique - A required process intended to reduce the level of a contaminant in drinking water.

• 2015 Results - Treated Source Water

Contaminant	Violation	Range (Low - High)	Average	MCL	MCLG	Likely source
Arsenic (ppb)	No	1.1 - 9.1	5.82	10	0	Erosion of natural deposits
Barium (ppm)	No	NA	0.04	2	2	Erosion of natural deposits
Nitrate (ppm)	No	0.29 - 7.2	4.03	10	10	Runoff from fertilizer use; Leaching from septic tanks; Erosion of natural deposits
Fluoride (ppm)	No	NA	0.51	4	4	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories
Alpha emitters (pCi/L)	No	NA	6.0	15	0	Erosion of natural deposits
Uranium (ppb)	No	NA	6.5	30	0	Erosion of natural deposits
Combined Radium (pCi/L)	No	NA	1.8	5	0	Erosion of natural deposits
Xylenes, total (ppb)	No	ND - 3.1	0.4	10	0	Discharge from petroleum factories; Discharge from chemical factories
Di-(2-ethylhexyl) phthalate (ppb)	No	ND - 0.68	0.0296	0.6*	0	Discharge from rubber and chemical factories

*Compliance based on local running annual average, not highest individual result.

Contaminant	Violation	TT % < 0.3	Highest result	TT requirement	MCL	Likely source
Turbidity (NTU)	No	100%	0.269	> 95%	1.0	Soil Runoff

• 2015 Results - Distribution System

Contaminant	Violation	Range (Low - High)	Average	MCL or MRDL	MCLG or MRDLG	Likely source
Total Coliform (% positive samples/month)	No	0 - 1.16	0	5	0	Naturally present in the environment
Bromate (ppb)	No	ND - 14	2	10	0	By-Product of drinking water disinfection
Chlorine (ppm)	No	0.31 - 2.12	0.90	4	4	Water additive used to control microbes
Haloacetic Acids (ppb)	No	ND - 30	19	60	NA	By-Product of drinking water disinfection
Total Trihalomethanes (ppb)	No	2.4 - 87	74	80	NA	By-Product of drinking water disinfection
Total Organic Carbon (% removal)	No	13.7 - 33.1	22.9	TT	NA	Naturally present in the environment

Contaminant	Violation	90 th percentile	Number over AL	Range (Low - High)	AL	ALG	Sampled	Likely source
Copper (ppm)	No	0.11	0	0.0023 - 0.32	1.3	NA	2013	Corrosion of house-hold plumbing systems; Erosion of natural deposits
Lead (ppb)	No	3.6	0	ND - 10	15	0	2013	Corrosion of house-hold plumbing systems; Erosion of natural deposits

• Additional Monitoring

In addition to sampling and testing your water as required by state, county and federal regulations, Gilbert's water division performs additional monitoring daily to ensure that the water treatment plants are operating efficiently, and to ensure the highest level of quality for your water. The following table shows the results of some of this additional monitoring. The compounds listed in this table do not have maximum contaminant levels enforceable by the EPA, and are used to characterize the aesthetic quality of the water.

Analyte	Average	Range (Low - High)
pH	7.78	7.22 - 8.15
Alkalinity (mg/L)	146	110 - 225
Conductivity (µs/cm)	1224	529 - 1855
TDS (mg/L)	783	338 - 1190
Calcium Hardness (mg/L)	168	80 - 251
Calcium Hardness (grains/gallon)	9.60	4.57 - 14.3

• Unregulated Contaminant Monitoring

This year Gilbert continued the third round of unregulated contaminant monitoring as required by the 1996 amendments to the federal Safe Drinking Water Act. Under this rule, the U.S. Environmental Protection Agency is required once every five years to issue a new list of up to 30 unregulated contaminants for which public water systems must monitor. The intent of this rule is to provide baseline occurrence data that the EPA can combine with toxicological research to make decisions about potential future drinking water regulations. In 2014, 30 unregulated compounds were surveyed in accordance with this program. They consisted of seven volatile organic compounds, one synthetic organic compound, six metals, one oxyhalide ion, six perfluorinated compounds, seven hormones and two viruses. Information regarding the compounds detected, the levels at which they were detected and the likely source of the contaminant can be found on the adjacent table. To learn more about unregulated contaminant monitoring and emerging contaminants, visit drinktaps.org/home/water-information/water-quality/ucmr3.aspx.

Contaminant	Average	Range (Low-High)	MCL	Likely source
Chlorate (ppb)	34	0 - 96	N/A	Disinfection byproduct, Agricultural defoliant
Hexavalent Chromium (ppb)	4.46	0 - 12	100*	Discharge from steel and pulp mills; Erosion of natural deposits
Molybdenum (ppb)	1.8	0 - 5.1	N/A	Erosion of natural deposits
Strontium (ppm)	447	0 - 1000	N/A	Erosion of natural deposits
Vanadium (ppb)	3.0	0 - 11	N/A	Erosion of natural deposits

*Hexavalent Chromium is currently regulated as a constituent of total chromium. The MCL for total chromium is 100ppb.

• Additional information on contaminants

• Arsenic

While your drinking water meets EPA's standard for arsenic, it does contain low levels of arsenic. EPA's standard balances the current understanding of arsenic's possible health effects against the costs of removing arsenic from drinking water. EPA continues to research the health effects of low levels of arsenic which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems.

- **Fluoride**

In April of 2015, the United States Department of Health and Human Services issued a revised recommendation for the optimal level of fluoride in drinking water. This revision lowered the recommendation from between 0.7 to 1.2 parts per million (ppm) as recommended by the department in 1962, to an optimal level of 0.7ppm. In Gilbert, voters have mandated that fluoride be added to the water supply at our two water treatment plants. These water treatment plants have maintained a target level of 0.7ppm in response to the 1962 recommendation, and will continue to do so as it is consistent with the revised recommendation.

A copy of the full United States Department of Health and Human Services report can be found at publichealthreports.org/documents/PHS_2015_Fluoride_Guidelines.pdf.

- **Lead**

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Gilbert is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at epa.gov/safewater/lead.

- **Nitrate**

Nitrate in drinking water at levels above 10ppm is a health risk for infants of less than six months of age. High nitrate levels in drinking water can cause blue baby syndrome. Nitrate levels may rise quickly for a short period of time because of rainfall or agricultural activity. If you are caring for an infant, you should ask for advice from your health care provider


- **Radiochemicals**

For Combined Radium 226/228, Uranium and Gross alpha emitters Gilbert failed to test at several sources during the monitoring period of 2010 to 2015. Because of this failure, we cannot be sure of the quality of the drinking water at those sources for the contaminants mentioned. To correct this deficiency, all sources previously in violation have been tested for radiochemicals in 2016, and the results of that testing are indicated in the following table:

Contaminant	Range (Low - High)	Average	MCL	MCLG	Health Risks
Alpha emitters (pCi/L)	0.6 - 7.9	2.9	15	0	Certain minerals are radioactive and may emit a form of radiation known as alpha radiation. Some people who drink water containing alpha emitters in excess of the MCL over many years may have an increased risk of getting cancer.
Uranium (ppb)	ND - 7.6	2.5	30	0	Some people who drink water containing uranium in excess of the MCL over many years may have an increased risk of getting cancer and kidney toxicity.
Combined Radium (pCi/L)	ND - 0.8	0.07	5	0	Some people who drink water containing combined radium in excess of the MCL over many years have an increased risk of getting cancer.

• Gilbert's commitment to Quality

Gilbert's Water Quality staff collects and analyzes the drinking water you receive at your home or business. These tests ensure that your water meets health and safety standards set by the state and federal government. Gilbert has a state certified laboratory which analyzes daily process, distribution and regulatory compliance samples. Each month, the Water Quality staff collects bacteriological samples from 150 designated water quality sampling stations across Gilbert to monitor the chlorine disinfectant level in the distribution system and to test for the presence of the microbial activity in the water. Our staff works diligently to ensure compliance with all drinking water regulations and to supply safe, high quality drinking water at a reasonable cost. Here are some of the ways that Gilbert's Water Quality department ensures that your water meets the highest standards:



Continuous Monitoring

- In addition to the instrument in our laboratories, Gilbert uses 95 online instruments to monitor water quality parameters every second to continuously analyze your water.
- These online instruments are located at Gilbert's two surface water treatment plants, as well as across the 17 well sites and 14 water storage reservoirs in Gilbert.
- Gilbert's two surface water treatment plants are staffed 24 hours a day, 365 days per year to ensure that your water is clean, safe and reliable.

Compliance Testing

- Gilbert's water quality department operates a state-certified compliance laboratory which is used to ensure your water meets rigorous state and federal water quality regulations.
- Samples are collected from the water treatment plants, well sites and dedicated Water Quality sample stations across Gilbert and tested to ensure quality, safety and compliance.
- For specialized testing, samples are also sent to a certified drinking water testing laboratory for in-depth analysis.

Process Control

- In addition to all of the testing required by the state and federal government, your water undergoes rigorous additional monitoring to ensure the highest quality water.
- This additional monitoring includes frequent testing for bacteriological contaminants, inorganic contaminants, trace metals and organic materials.
- This testing is used to optimize surface water treatment plant operations to adjust to changes in incoming water quality and guarantee safe drinking water is produced.